
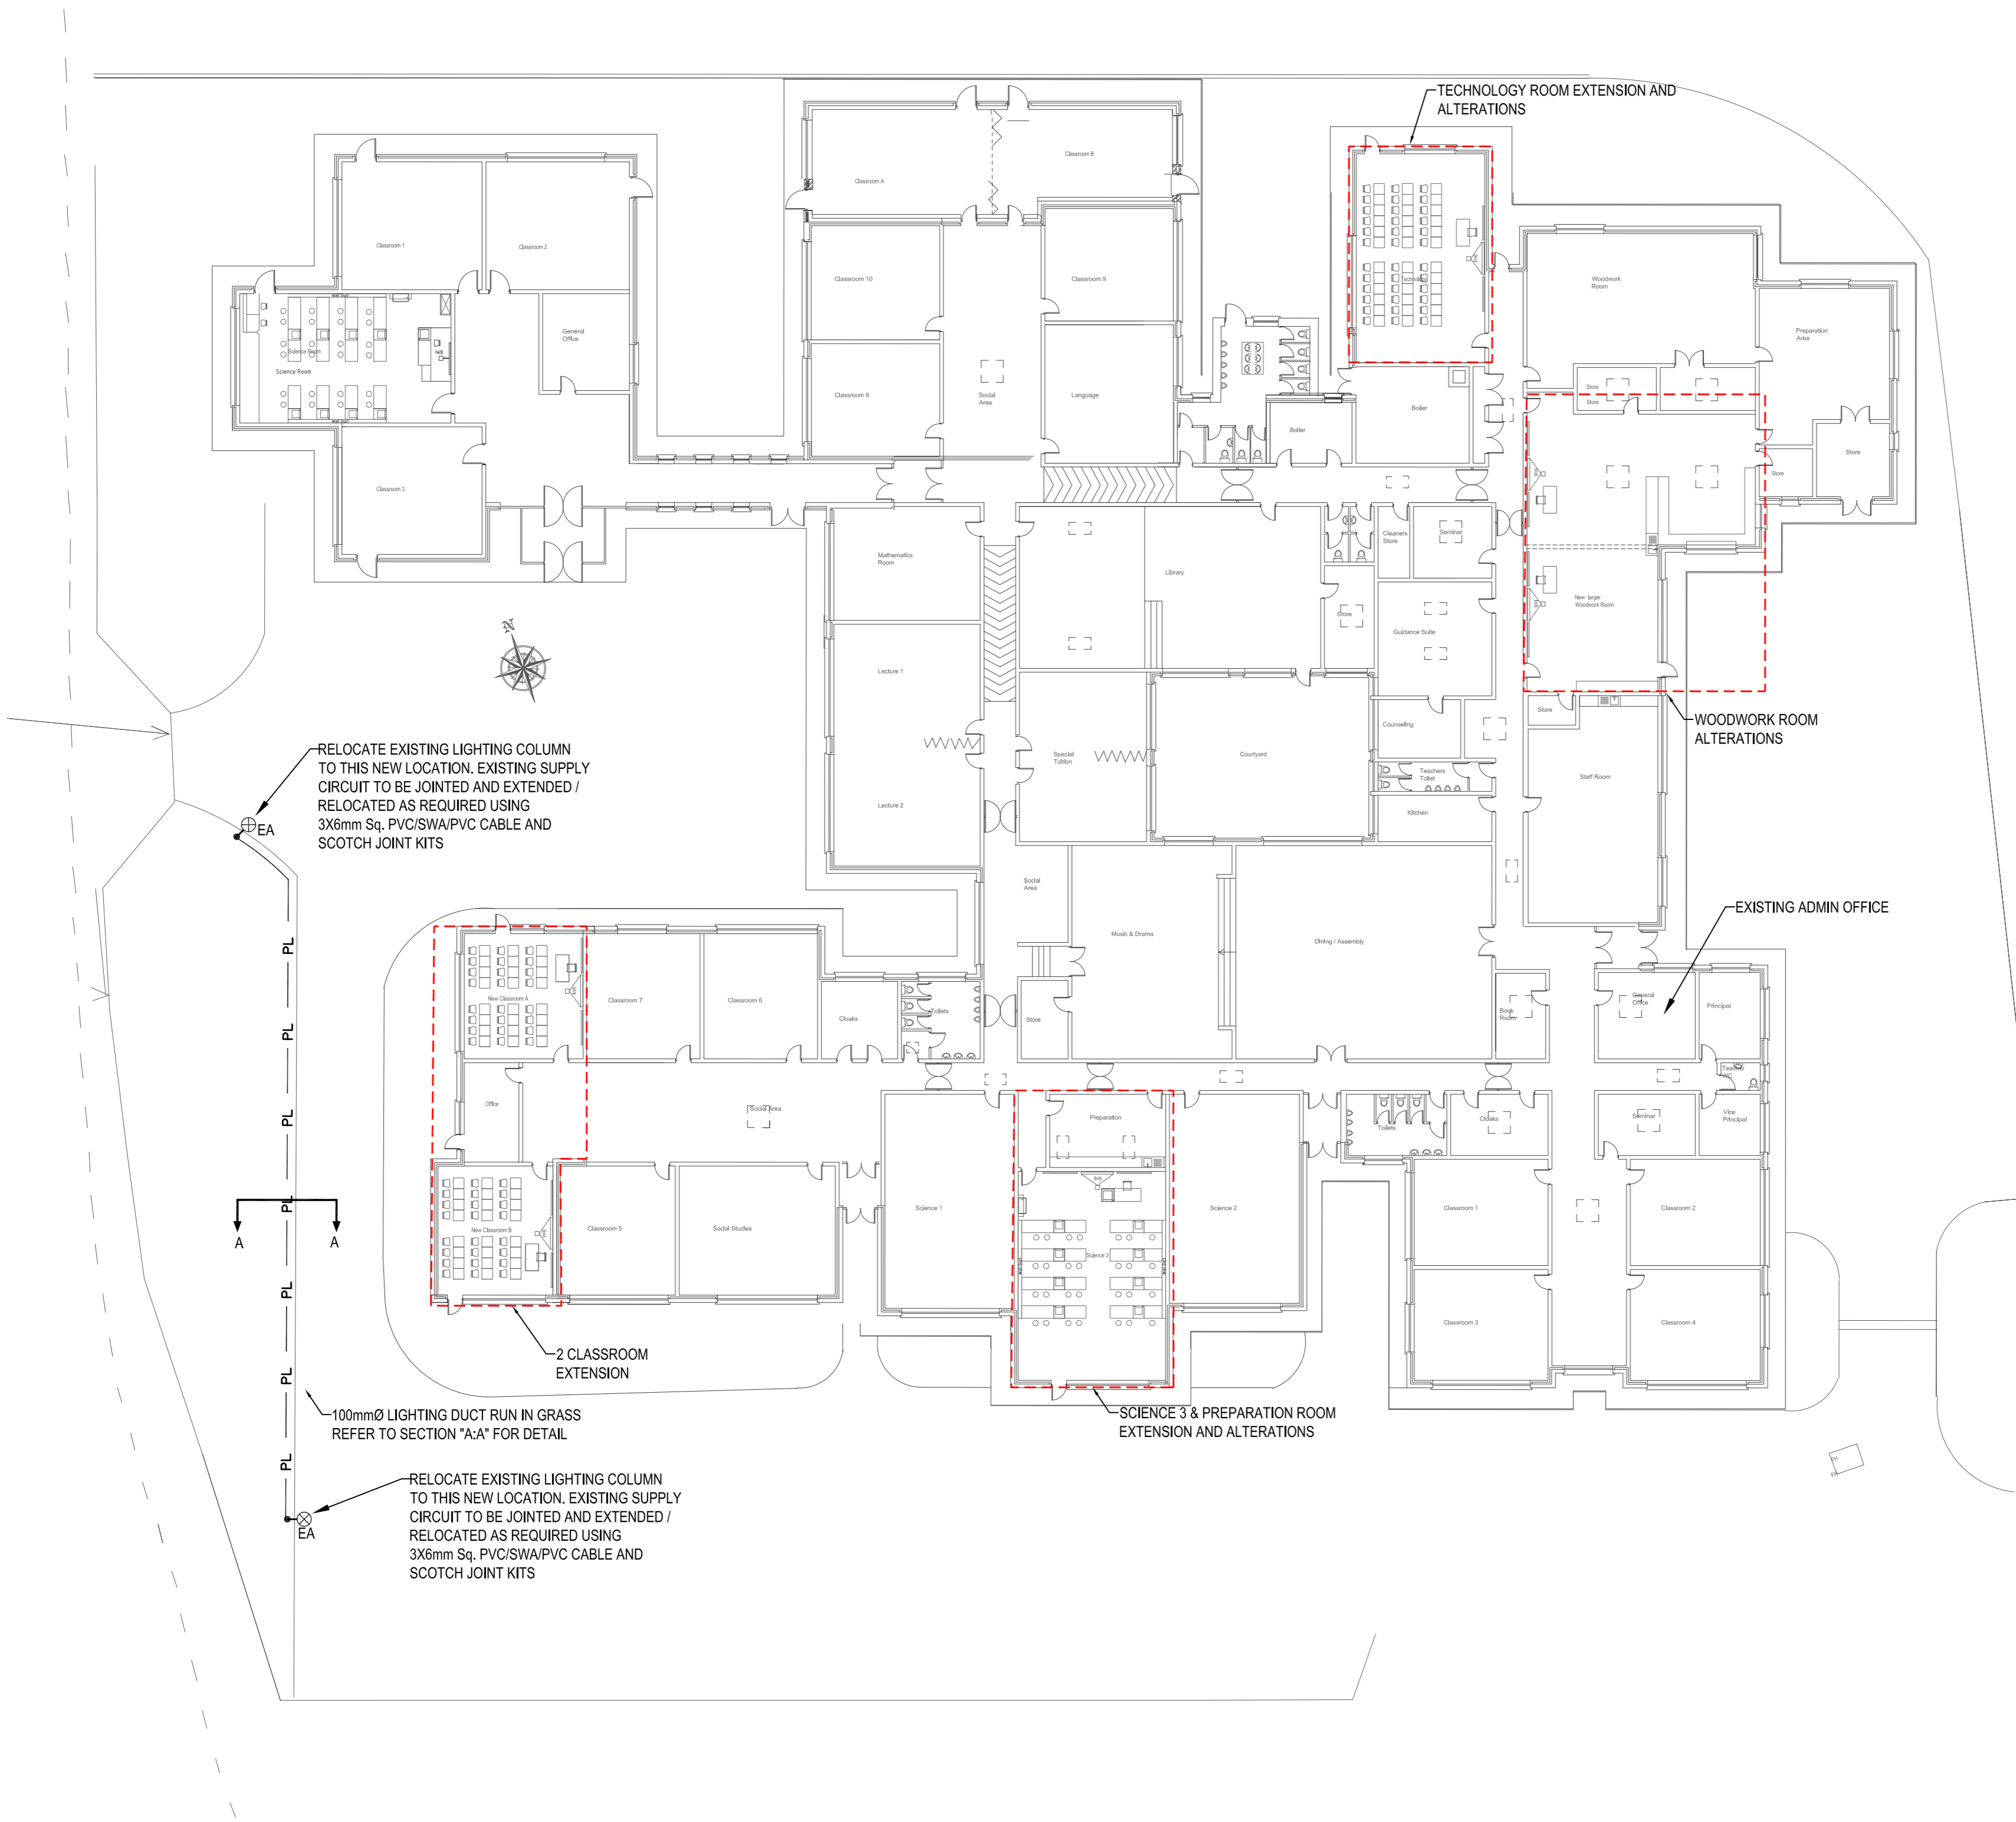


NOTES

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER CONTRACT DRAWINGS & SPECIFICATIONS.
- DUCTING LOCATIONS SHOWN ARE INDICATIVE ONLY. FINAL LOCATIONS SHALL BE COORDINATED WITH DRAINAGE AND ALL OTHER SERVICES BY THE CONTRACTOR
- THE CONTRACTOR SHALL OBSERVE THE REQUIRED SEPARATION DISTANCES FOR EACH UTILITY FROM ALL OTHER UNDERGROUND SERVICES.
- ALL DUCTS SHALL BE FITTED WITH A 10mm NYLON DRAW ROPE.
- THE CONTRACTOR SHALL NOTE THAT ALL CABLE DUCTING SHALL BE INSTALLED SUCH THAT IT WILL NOT BE SUSCEPTIBLE TO ANY SUBSIDENCE OR SETTLING.
- ALL DUCT RISERS WITHIN BUILDING TO BE SEALED VERMIN PROOF ON COMPLETION OF CABLE INSTALLATION.

LEGEND

- PL 1 No. 100mm Ø PVC DUCT FOR PUBLIC LIGHTING INSTALLED 750MM BELOW FINISHED ROAD LEVEL AND 450mm BELOW GRASS MARGIN WITH WARNING TAPE 300mm ABOVE. PROVIDE 10mm NYLON DRAW ROPE
- EA  EXISTING 6 METER LIGHTING COLUMN CAREFULLY RELOCATED TO NEW POSITION SHOWN



T0	TENDER ISSUE	SR	JF	JF	29/06/17
REV	DESCRIPTION	BY	CHK	APP	DATE

Client:

BOARD OF MANAGEMENT CBS THURLES
ROSSA STREET, THURLES
Co TIPPERARY



SHANACLOGH,
CAPPAWHITE,
Co. TIPPERARY.

TEL: +353 (0) 62 75929
EMAIL: info@force.ie
WEB: www.force.ie

Project:


CBS THURLES SECONDARY SCHOOL
PROPOSED EXTENSIONS WORKS 2017

Drawing Title:

PROPOSED SITE LIGHTING LAYOUT
&OVERALL BUILDING KEY PLAN

Scale @ A1 1:250	Drawn SR	Checked JF	Approved J. Fahey	Date 29/06/17
Project No. 1716	Type E	Drawing No. 1716-EX-01	Revision T0	

APPROVAL ☐ INFORMATION ☐ TENDER ☒ CONTRACT ☐ CONSTRUCTION ☐



A:A TYPICAL SECTION THROUGH SERVICES IN GRASS
EX-01 SCALE: 1:20